

Energy consumption in hospital buildings: functional and morphological evaluations of six case studies

M. COCCAGNA ¹, S. CESARI ², P. VALDISERRI ³, P. ROMIO ⁴, S. MAZZACANE ¹

¹ CIAS Research Center for pollution control in high sterility rooms, Department of Architecture

University of Ferrara

via Saragat 13, 44122 Ferrara, ITALY

maddalena.coccagna@unife.it, sante.mazzacane@unife.it

² Department of Architecture

University of Ferrara

via della Ghiara 36, 44121 Ferrara, ITALY

silvia.cesari@unife.it

³ Department of Industrial Engineering

University of Bologna

Viale Risorgimento 2, 40136 Bologna, ITALY

paolo.valdiserri@unibo.it

⁴ AUSL Bologna

Via Castiglione 29, 40124 Bologna, ITALY

pasquale.romio@ausl.bologna.it

Abstract: - Whilst accounting for 7,5% of the total built area within the non-residential sector [1], hospitals are responsible for 10% of the total energy use in Europe [2] and are estimated to contribute roughly 5% of the carbon dioxide emissions [3]. Healthcare facilities are characterised by an extremely high demand for electricity, heating and cooling throughout the year. In addition to this, the steady changes in the procedures of care delivery, due to the fast-moving advances of the diagnostic techniques, require the continuous remodelling of the existing spaces in operative structures, involving both architectural-distributive aspects and the building plant systems. This process deeply impacts hospital energy consumption, underlining the need of forecasting these new dynamics also in terms of costs.

Against this background, the aim of the work consists in the development of a numerical model for the annual energy consumption assessment of six hospitals located in the province of Bologna (Italy), in relation to the different departments, the type of HVAC system, the morphological features of the buildings and the levels of insulation, the ventilation and humidification rates, etc. The numerical model was then tested for each healthcare facility through the use of instruments for the continuous monitoring of the real hospital energy usage. The model allows to forecast the energy consumptions related to the refurbishment or modification of existing hospitals, exploring the impact of architectural and functional features, as well as of energy goals.

The main aspect of the work is represented by the methodological framework, which has been based on the identification of the energy needs and consumptions from micro (single spaces) to macro scale (macro-area).

In this paper are reported the preliminary results of the work regarding the morphological aspects of the six hospitals analysed and the distribution of the condition floor area in relation to the type of spaces.

Key-Words: - Hospitals, Energy Consumption, Morphological Aspects, Functional Features, Measurement, Benchmarking, Prediction, Departments

1 Introduction

Buildings are the largest energy consuming sector in the world [4], accounting for 20% of the total delivered energy consumed [5]. At EU level, the building sector is responsible for 40% of final energy consumption and 36% of green-house gas emissions [1-2, 6-7], one third of this is due to non-residential buildings [8]. Whilst accounting for 7,5%

of the total built area within the non-residential sector [9], hospitals present the highest energy consumption per unit of floor area [10]. They contribute 10% of the total energy use [2] and are estimated to account for roughly 5% of the EU carbon dioxide emissions [3] (in 2013 the U.S. healthcare sector produced 9.8% of the national total [11]). Therefore, while they should be designed to

improve public health and respect the environment, hospitals are actually contributing to the very problem they are trying to solve, and their negative effects are proportional to their age.

Taking into consideration the EU healthcare building stock, an average of 60% of the structures date back to before 1980, while only about 15% were built after 2000 [12]. As regards the Italian context, 4% of the operative hospitals were built before 1950, with 4 of them even dating back between 1846 and 1888. Today, the majority of the healthcare building stock (66%) is characterised by structures opened between 1950 and 2000, outdated both from the architectural and operational point of view, while only the 30% of the complexes were built in the last twenty years [13].

High hospitals' energy consumptions are mostly due to extremely high demands for space heating and cooling throughout the year, caused by the need of high ventilation rates and the strict requirements for microclimatic control [14-16]. Also the demand of district hot water (DHW) is substantial [17], as well as the need of electricity [18-20, 21, 22]. In addition, the steady changes in the procedures of care delivery, due to the fast-moving advances of the diagnostic techniques, require the continuous remodelling of the existing spaces in operative healthcare facilities, involving both architectural-distributive aspects and building plant systems. This process deeply impacts hospital energy consumption, underlining the need of forecasting these new dynamics also in terms of costs.

Thus, the economic sustainability of a healthcare facility results to be a fundamental aspect. At European level, the global health expenditure has risen of about 20% in the last twenty years, reaching 30% for the Italian context and bringing healthcare management to an unsustainable condition [23]. Albeit energy costs are often seen as fixed costs, in the financial performance of the hospital every dollar saved in energy and operating costs is equal to generating \$20 growth in new top line revenues [24]. Therefore, energy savings can be viewed as an ongoing, high yield, low risk investment or revenue stream that enable to reduce costs without impacting medical services.

Against this background, and in view of the increasingly stringent energy efficiency targets and environmental issues, the need of a more robust and reliable focus on hospital energy assessment is becoming more and more important, also considering that a growing number of studies have uncovered a mismatch between the predicted energy performance of buildings and their actual measured

energy use and resulting utility bills, an issue addressed as 'the performance gap' [25-28].

Nevertheless, the assessment of energy performance and retrofit potentials for hospital buildings is very arduous because of the substantial size, energy-intensity and heterogeneity [29], together with the lack of energy data from a sufficiently large number of buildings for benchmarking [21]. In the following section, a state of the art review of the existing studies about the evaluation and prediction of hospital energy behaviour is reported.

2 State of the art

The current scientific literature about energy performance assessment and forecasting models for healthcare facilities includes a huge variety of approaches which largely differ in the method of analysis, the energy issues investigated, the type of building – existing or prototype – or hospital spaces to which the method is applied, as well as the scale at which the research work is conducted.

The main methods are briefly reviewed in [28]. Here are presented the first-principle models, which span from stationary calculations, via semi-dynamic methods, to dynamic simulation; the machine learning approach, which requires training data provided by either measurements or first-principle models; measurements, which include metering the energy delivered at building or sub-systems level on the basis of different temporal resolution and allow to capture energy-related data, such as indoor and outdoor conditions, occupancy, and control systems.

An analysis of the studies available in literature shows that the majority of the works are based only on dynamic thermal simulation models [24, 29-37], albeit some recent approaches also employ measurement data in order to calibrate the model [16, 38-43]. Indeed, since the late '70s, building simulation is a well-recognized method for the building energy performance assessment [44]. The method is used both to predict the indoor air temperature and humidity in time-dependent external weather conditions and to assess the influence of different buildings features on the building thermohygrometric behaviour and comfort [45]. Nevertheless, simulation-based methods are characterised by several difficulties in properly modelling the building-HVAC system for large structures, like hospitals, and by time consuming simulations. Large models can also limit the number of possible simulations, since even modest retrofit proposals could imply changes to many parameters [16].

Conversely, simplified steady-state models, often purposely developed, are based on empirical and/or experimental mathematical models. In particular, the adoption of simplified methodologies related to several control techniques able to assess the possibilities for increasing energy efficiency in hospitals were presented in Refs. [15, 46]. Here, the tool, which was tested and calibrated at the new emergency hospital located in Novi Sad, Serbia, enables fast analyses by avoiding complex dynamic modelling. Finally, some approaches are based only on on-site measurements [19, 21, 22].

Taking into consideration the energy aspects investigated, it arises that, although a comprehensive analysis of the energy behaviour of hospital buildings should consider all levers affecting energy performance, current scientific literature does not provide worthy studies that explored all the energy related aspects. Čongradac et al. [15] focused on hospital heating and cooling energy consumption, while other works investigated only electricity [19-22, 47, 48], heat consumption for DHW [17], or comfort in healthcare environments [32, 38, 39, 49, 50]. Differently, a wide variety of studies deeply explored the benefits and cost-effectiveness of energy retrofit measures (ERMs) and energy saving measures (ESMs), making a comparative analysis between different strategies [16, 29, 40, 46] or focusing on only one of them and exploring some variations of it [9, 30, 31, 41-43, 51, 52].

A more critical review of the hospital building type and spaces examined in literature shows that these methods were rarely applied to existing and operative hospital structures [15, 40, 42, 43, 46]. Most of the studies were developed considering a reference building representative of the hospital building category. Nevertheless, each reference building was defined on the base of different criteria, like the standards reported by regulations [24, 33-37], statistical data coming from a large number of hospitals [29], hospital templates or reports and datasets providing typical hospital characteristics [24, 33-36], or the parameters dictated by the method employed [32]. Again, several studies took into consideration only single hospital spaces (like a department) [19, 21, 22, 30, 38, 39, 41], or only some buildings representative of the healthcare complex [16-31], due to the difficulties in modelling, calibrating, predicting and interpreting results for all the hospital spaces [16].

In addition, the majority of the aforementioned approaches analysed the hospital (either existing or prototype) at building level, or focused just on some healthcare spaces or departments. Only few works

investigated the whole hospital at departmental level [15, 24, 29, 33-37, 46]. Nevertheless, these studies did not refer all the energy related aspects to this space distinction.

Against this background, the Advanced Energy Design Guides (AEDGs) for Large Hospitals [33] and for Small Hospitals and Healthcare Facilities [24] – a product of a collaboration between ASHRAE, AIA, IES, USGBC, and DOE – together with the related Technical Support Documents (TSDs) [34, 36] and a study developed by the University of Washington's Integrated Design Lab (IDL) [37], represent more comprehensive works. These studies thoroughly investigated the energy behaviour of hospital buildings by considering all the energy related aspects at departmental level. The works employed the dynamic thermal simulation approach applied to baseline and low-energy reference buildings in different climate zones. More in detail, the two AEDGs [24, 33] analysed baseline and energy saving parameters regarding the building envelope, vertical fenestration, lighting, HVAC, service water heating (SWH) and plug and process loads (PPLs), then developing specific ESMs. The guides use the macro-level classification of hospital spaces – the same used in scientific literature and regulation [53-57] – distinguishing between Inpatient Units (IPUs), Diagnostic and Treatment Facilities (D&T), and nonclinical spaces, and provide prescriptions regarding daylighting, space layout and lighting power densities (LPDs) in relation to these three macro-areas.

Conversely, the three TSDs [34-36], which integrate the AEDGs, include a more comprehensive analysis of the surface distribution of hospital prototype distinguishing by all the space types. To the space categories identified were referred baseline and energy saving values for ventilation, LPDs, PPLs and SWH loads.

Similarly to the TSDs, the work of the University of Washington's IDL [37] is based on an accurate distinction of the spaces according to their use. However, to this distinction are not referred any of the specifications provided by the work and regarding the building envelope, vertical fenestration, external surface, building and plant systems, electricity and natural gas consumption, etc.

The lack of worthy studies on hospital energy behaviour at departmental level represents a critical knowledge gap in the literature. Indeed, hospitals are known to show a very large variety of area specific energy consumption [58]. Different departments and space types have different morphological characteristics, plant systems,

conditioning requirements, occupancy, area, equipment, etc. Therefore, it is different their energy consumption and, what is the most important, the possibility of savings [15, 21, 33]. For this reason, the academic literature has pointed out that hospital energy benchmarks need to be resolved for as specific an area as possible [59-60].

Summarising, the review of the existing studies presented above underlines a series of critical issues regarding hospital energy behaviour assessment and prediction. Firstly, the shortage of works primarily based on measurement data causes a lack of data measured and estimated energy consumptions for hospital buildings. Secondly, a lack of studies exploring hospital energy performance by carefully considering the huge domain of the affecting factors means that the outcomes available in literature are strictly dependent on the investigated loads pattern and cannot be extended to different buildings functions and to different locations [15, 61]. This aspect, together with the absence of studies examining large samples of whole existing operative structures, also hinders the construction of more robust and reliable energy benchmarking. Again, despite increasing research activity in the past decade, it arises that energy analyses are still rarely based on departmental level, thus hospital energy consumption by space type remains largely unexplained [20].

3 Structure of the method of analysis

The aim of the work consists in the development of a numerical model for the annual hospital energy consumption assessment of six hospitals located in the province of Bologna, Italy, in relation to the different departments, medical functions, type of HVAC system, morphological features of the buildings and levels of insulation, ventilation and humidification rates, operating hours, contribution of active and passive energy recovery systems, etc. Although the research has been considering different hospitals within the national context, six hospitals located in the same province have been chosen in order to avoid the climate variables between different regions.

The numerical model was then tested for each healthcare facility through the use of equipment, instruments for the continuous monitoring of technical and physical parameters, and heat meters, which made it possible to monitor the real hospital energy consumption according to the type of management and the climate trends.

The model allows to forecast the energy consumptions related to the refurbishment or

modification of existing hospitals, analysing the impact of architectural and functional features, as well as of energy goals.

The main aspect of the work is represented by the methodological framework, which has been based on the identification of the energy needs and consumptions from micro (single space) to macro scale (macro-area). Indeed, the main purpose is to go beyond the existing studies reviewed in section 2, which look at the healthcare structure as a single and unique element of consumption, without a separation between different space types.

Actually, the setup of the whole method of analysis is aimed at addressing the weaknesses of the studies available in literature. Indeed, the exclusive use of measurement data collected from existing and operative hospitals provides a robust and reliable dataset and avoids the inaccuracies that can come from thermal building simulation methods. Furthermore, the model developed takes into consideration all the factors affecting building energy behaviour, providing a comprehensive tool.

The objective of the work, omitting complex dynamic modeling, is also to develop a method as simple as possible, which enables fast obtaining of fairly reliable results, being primarily intended for ordinary engineers, architects, technical staff responsible for the maintenance of healthcare facilities and energy managers.

Each healthcare facility was considered floor by floor and the spaces were distinguished in relation to the single space (micro scale), the functional area (FA) (medium scale), and the macro-area (macro scale) (see Table 1), according to the taxonomy of hospital spaces used in scientific literature and regulation [24, 33, 53-57].

| Macro-Area | Functional area | Single space |
|--------------------------------|------------------------------|---|
| Inpatient Units (IPUs) | Inpatient units | Patient rooms Examination rooms Medical offices Administrative offices Toilets and dressing rooms Connective spaces Storage rooms Technical spaces and services for patients and visitors* |
| Diagnostic and Treatment (D&T) | Accident and Emergency (A&E) | A&E specific spaces (observation unit, triages, etc.) Diagnostic/examination rooms Medical offices Administrative offices Toilets and dressing rooms Connective spaces Storage rooms |
| | Medical offices | Medical offices Toilets and dressing rooms Connective spaces Storage rooms |

| | | |
|-----------------------------|---|---|
| | | Technical spaces and services for patients and visitors* |
| Laboratories | Laboratories Medical offices Administrative offices Toilets and dressing rooms Connective spaces Storage rooms Technical spaces and services for patients and visitors* | |
| Operating theatres | Operating rooms (ORs) and support spaces Toilets and dressing rooms Connective spaces Storage rooms Technical spaces and services for patients and visitors* | |
| Outpatient department (OPD) | Consulting/examination/treatment rooms Medical offices Administrative offices Toilets and dressing rooms Connective spaces Storage rooms Technical spaces and services for patients and visitors* | |
| Diagnostic imaging | Diagnostic/examination rooms Medical offices Administrative offices Toilets and dressing rooms Connective spaces Storage rooms Technical spaces and services for patients and visitors* | |
| General services | Kitchens and canteens | Kitchen and canteen specific spaces Toilets and dressing rooms Connective spaces Storage rooms |
| | Mortuary | Mortuary and support spaces Toilets and dressing rooms Connective spaces Storage rooms |
| | Admin. offices | Offices Toilets Connective spaces Storage rooms |
| | Toilets and dressing rooms | Toilets and dressing rooms |
| | Connective spaces | Connective spaces |
| | Storage rooms | Storage rooms |
| | Technical spaces and services | Technical spaces and services for patients and visitors* |

*include mechanical spaces, meeting rooms, cafeteria, lounges, pharmacy, rehabilitation gym and ancillary spaces, chapel, etc.

Table 1. Subdivision of hospital spaces

The research results for each energy related aspect analysed have always been reported both at single space level and at functional area level, like in the following example.

| Single space | A | B | C | D | E | F |
|----------------------|---|---|---|---|---|---|
| Patient rooms* | | | | | | |
| A&E specific spaces* | | | | | | |

| | | | | | | |
|--------------------------------------|--|--|--|--|--|--|
| Medical offices* | | | | | | |
| Administrative offices* | | | | | | |
| Laboratories* | | | | | | |
| ORs and support spaces* | | | | | | |
| Consulting/Examination rooms* | | | | | | |
| Diagnostic/Examination rooms* | | | | | | |
| Kitchen and canteen specific spaces* | | | | | | |
| Mortuary and support spaces* | | | | | | |
| Toilets and dressing rooms | | | | | | |
| Connective spaces | | | | | | |
| Storage rooms | | | | | | |
| Technical spaces and services | | | | | | |
| Macro-Areas | | | | | | |
| Inpatient units | | | | | | |
| Diagnostic and Treatment | | | | | | |
| General services | | | | | | |

*as outlined in Table 1, these are single spaces and do not include toilets, connective spaces, storage rooms, technical spaces and services, as well as other support spaces.

| Functional area | A | B | C | D | E | F |
|-------------------------------|---|---|---|---|---|---|
| Inpatient units* | | | | | | |
| Accident and Emergency (A&E)* | | | | | | |
| Medical offices* | | | | | | |
| Administrative offices* | | | | | | |
| Laboratories* | | | | | | |
| Operating theatres* | | | | | | |
| Outpatient department* | | | | | | |
| Diagnostic imaging* | | | | | | |
| Kitchens and canteens* | | | | | | |
| Mortuary* | | | | | | |
| Toilets and dressing rooms | | | | | | |
| Connective spaces | | | | | | |
| Storage rooms | | | | | | |
| Technical spaces and services | | | | | | |
| Macro-Areas | | | | | | |
| Inpatient units | | | | | | |
| Diagnostic and Treatment | | | | | | |
| General services | | | | | | |

*as outlined in Table 1, these are FAs and include toilets, connective spaces, storage rooms, technical spaces and services, as well as the support spaces specific of each FA.

This distinction by space type was essential also to make a comparative analysis of the research results between the hospital case studies.

In this paper are reported in a parametric form the preliminary results of the work, regarding the morphological aspects of the six hospitals analysed and the distribution of the condition floor area in relation to the type of spaces.

3.1 Case studies

The research analysed six hospitals taken as case studies (Table 2-3) and identified as Hospital A, B, C, D, E and F, which are located in the Emilia Romagna region (Italy), nationally recognized as a best practice in healthcare delivery. All the healthcare structures belong to the LHU of Bologna, the main province of the region.

| Data | | A | B | C | D | E | | F |
|-----------------|-----------|---|---|---|---|-------|------|---|
| | | | | | | orig. | add. | |
| Year of Constr. | 1900-1940 | ✓ | | | ✓ | ✓ | | |
| | 1940-1980 | | ✓ | ✓ | | | | ✓ |

| | | | | | | | |
|--|-------------------------|-------|-------|--------|--------|---|--------|
| | 1980-2000 after 2000 | | | | | | |
| Conditioned floor area (m ²) | 3.385 | 6.033 | 8.185 | 13.165 | 50.786 | ✓ | 88.901 |
| S/V* | 0,43 | 0,54 | 0,43 | 0,56 | 0,43 | | 0,34 |
| S/Conditioned floor area | 1,36 | 1,47 | 1,54 | 1,51 | 1,45 | | 1,11 |

*S = external surface and V = conditioned volume

Table 2. Main characteristics of the hospitals analysed

| Departments | A | B | C | D | E | F |
|--------------------------------|----|----|-----|-----|-----|-----|
| Anaesthetics | | | ✓ | ✓ | ✓ | ✓ |
| Breast care | | | | ✓ | ✓ | ✓ |
| Cardiology | | | | ✓ | ✓ | ✓ |
| Care of the elderly | | | | ✓ | | ✓ |
| Dialysis | | | ✓ | | | |
| Ear nose and throat (ENT) | | | ✓ | | | ✓ |
| Endocrinology | | | | ✓ | ✓ | ✓ |
| Extensive Rehabilitation | | | ✓ | | ✓ | |
| Accident and Emergency | ✓ | ✓ | ✓ | ✓ | | ✓ |
| Functional Rehabilitation | | ✓ | | | | |
| Gastroenterology | | ✓ | ✓ | ✓ | ✓ | ✓ |
| General surgery | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Gynaecology | | ✓ | ✓ | | | ✓ |
| Internal Medicine | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Long-term care | | | | ✓ | ✓ | ✓ |
| Maternity and Gynaecology | | ✓ | ✓ | ✓ | ✓ | ✓ |
| Medical laboratory | | ✓ | ✓ | ✓ | ✓ | ✓ |
| Neurology | | | | | ✓ | ✓ |
| Oncology | | | ✓ | ✓ | ✓ | |
| Ophthalmology | | ✓ | | ✓ | | ✓ |
| Orthopaedics | ✓ | | | ✓ | | ✓ |
| Pediatrics | | | | ✓ | | ✓ |
| Radiology | | ✓ | ✓ | ✓ | ✓ | ✓ |
| Rehabilitation Medicine | | | | ✓ | ✓ | ✓ |
| Specialized Surgery | | | | ✓ | ✓ | ✓ |
| Urology | | | | | | ✓ |
| Number of hospital beds | 34 | 92 | 114 | 211 | 372 | 654 |

Table 3. Hospitals' departments and number of hospital beds

4 Analysis of the healthcare functions

Similarly to the investigation methodology used by Congradac et al. [15], the entire hospital buildings were created in Excel and defined room by room, to which were referred the measurement data collected.


As reported in Table 4-5 and in Figs. 1-2, the research findings regarding the percentage distribution of the conditioned floor area for the six hospitals were compared to the values reported in Refs. [34-37]. Although the studies exposed in the Refs. used building simulation methods and were based on prototype buildings and not real case studies, they were selected for the comparison since they are the only ones which analysed the hospital building by making a clear and comprehensive distinction of the spaces in relation to their use.

In order to aid a proper interpretation of the first results, it is necessary to underline that the TSD for

Small Hospitals and Healthcare Facilities [36] refers to structures with a surface up to about 8.000 m², such as hospitals A, B and C, while the TSD for Large Hospital [34-35] regards structures with a surface ranging from about 9.000 to 46.000 m², a category to which hospitals D, E and F belongs. The study developed by the University of Washington's IDL [37] analyses two types of hospital building form: a traditional and compact form, like hospitals A, C, E and F whose S/V ratio ranges from 0,34 to 0,43, and a more articulated one, like hospitals B and D, having a S/V ratio between 0,54 and 0,56 (see Table 2). In addition, both the TSDs analysed the hospital spaces at single space level, while the work of the IDL distinguished the spaces at department level. For this reason, the analysis of the six hospitals at single space level is compared to the results of the TSDs, while the analysis of the hospitals at functional area level is compared to the values reported by the IDL.

| Single space | Conditioned floor area (%) | | | | | | | |
|---------------------------------|----------------------------|----|----|----------|-----------------|----|----|----------|
| | Small hospitals | | | | Large hospitals | | | |
| | A | B | C | TSD [36] | D | E | F | TSD [35] |
| Patient rooms | 17 | 14 | 15 | 10 | 16 | 10 | 12 | 24 |
| A&E specific spaces | 2 | 1 | 0 | 1 | 1 | 0 | 0 | 2 |
| Medical offices | 5 | 7 | 6 | 22 | 6 | 8 | 7 | 21 |
| Administrative offices | 6 | 7 | 6 | | 7 | 5 | 5 | |
| Laboratories | 2 | 5 | 3 | 2 | 4 | 3 | 3 | 3 |
| ORs and support spaces | 7 | 3 | 2 | 7 | 2 | 3 | 3 | 8 |
| Consulting/Examination rooms | 8 | 9 | 9 | 6 | 12 | 6 | 6 | 5 |
| Diagnostic/Examination rooms | 2 | 2 | 2 | 2 | 1 | 3 | 2 | 3 |
| Kitchen/Canteen specific spaces | 4 | 4 | 3 | 3 | 2 | 2 | 3 | 2 |
| Mortuary and support spaces | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 |
| Toilets and dressing rooms | 9 | 9 | 10 | 5 | 9 | 10 | 9 | 1 |
| Connective spaces | 29 | 29 | 32 | 23 | 34 | 36 | 40 | 16 |
| Storage rooms | 5 | 3 | 5 | 9 | 1 | 7 | 5 | 10 |
| Technical spaces and services | 5 | 6 | 5 | 11 | 5 | 7 | 5 | 6 |

Table 4. Distribution of the conditioned floor area in relation to the use of the spaces in small and large hospitals

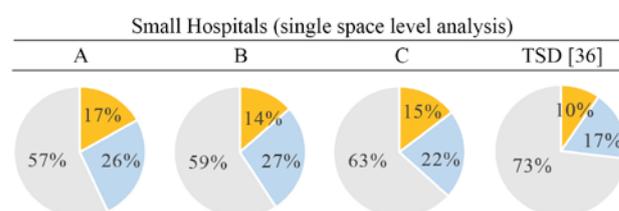

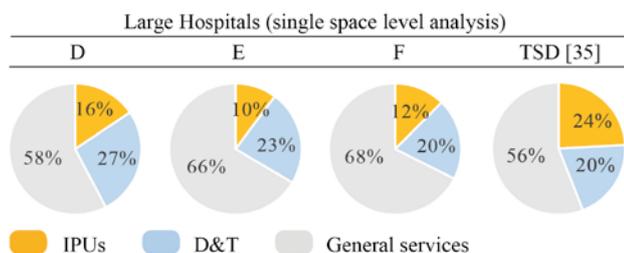


Fig.1 Distribution of the conditioned floor area in relation to the three macro-areas in small and large hospitals

| Functional area | Conditioned floor area (%) | | | | | | | |
|-------------------------------|----------------------------|----|----|----|----------|--------------------------------|----|----------|
| | Hosp. with a compact form | | | | | Hosp. with an articulated form | | |
| | F | A | C | E | IDL [37] | B | D | IDL [37] |
| Inpatient Units | 33 | 31 | 27 | 35 | 32 | 26 | 34 | 42 |
| A&E | 1 | 3 | 8 | 0 | 4 | 2 | 3 | 4 |
| Medical offices | 3 | 4 | 5 | 4 | 11 | 5 | 5 | 10 |
| Administrative offices | 4 | 3 | 6 | 3 | | 6 | 4 | |
| Laboratories | 4 | 2 | 3 | 4 | 3 | 7 | 5 | 3 |
| Operating theatres | 8 | 10 | 4 | 6 | 9 | 5 | 4 | 9 |
| Outpatient department | 8 | 14 | 6 | 9 | 0 | 11 | 18 | 0 |
| Diagnostic imaging | 4 | 4 | 4 | 9 | 6 | 4 | 3 | 6 |
| Kitchens and canteens | 4 | 6 | 3 | 2 | 2 | 4 | 4 | 2 |
| Mortuary | 1 | 0 | 1 | 1 | 0 | 1 | 0 | 0 |
| Toilets and dressing rooms | 3 | 4 | 5 | 4 | 0 | 2 | 4 | 0 |
| Connective spaces | 22 | 14 | 20 | 15 | 20 | 16 | 13 | 11 |
| Storage rooms | 1 | 1 | 3 | 3 | 3 | 4 | 0 | 3 |
| Technical spaces and services | 3 | 4 | 5 | 5 | 9 | 6 | 3 | 9 |

Table 5. Distribution of the conditioned floor area in relation to the use of the spaces in hospitals with a compact form and in those with an articulated one

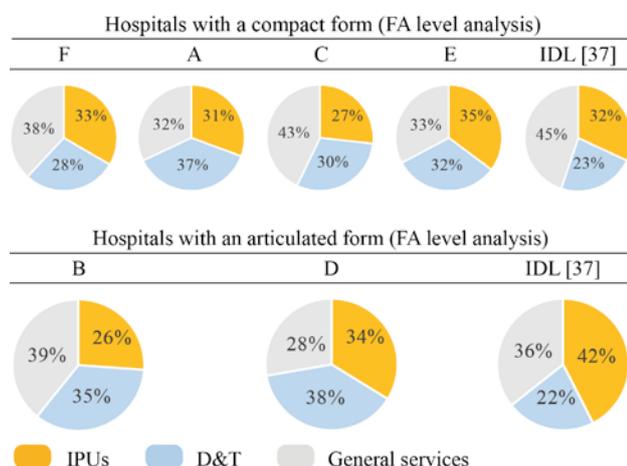


Fig.2 Distribution of the conditioned floor area in relation to the three macro-areas in hospitals with a compact form and in those with an articulated one

Despite healthcare is characterised by the steady shift from inpatient toward outpatient care, the data exposed above show that patient rooms at single space level and IPUs at functional area level are the second and the first space type, respectively, to have an extremely high impact on the distribution of the conditioned floor area, preceded and followed by connective spaces.

However, for a proper interpretation of the data is necessary to underline that half of the hospitals analysed date back to before 1940, while the others were built before 1980. Therefore, considered the difficulties in space flexibility and layout reorganisation typical of outdated structures, the decrease of patient rooms is less visible in the case studies examined. This process is more evident in the analysis of the conditioned floor area at macro-area level, which underlines that general services are the most impacting space category.

Besides patient rooms and Inpatient Units, consulting and examination rooms, at single space level, and operating theatres and outpatient department, at functional area level, have a quite important role in the distribution of the hospital conditioned floor area, due to the advances in medical procedures and the trend from inpatient toward ambulatory care.

5 Conclusions and future developments

The results of the analysis of the six hospitals examined show that the ongoing evolution in clinical and surgical therapy is bringing consistent changings in the organisational and layout features of the interior spaces. Parts of the hospital structure are reorganized to reflect new patterns of treatment.

Spaces previously destined for patient rooms, and IPUs in general, are decreasing in favor of non-clinical spaces and general services, like public connective spaces, patients and visitors specific facilities, administrative and storage areas, etc. The progress of medical techniques and technology and the use of new pain medications and antibiotics are allowing to significantly reduce the patient length of stay. These process, together with the financial and economic crisis and the political pressure to reduce healthcare expenditures, brought to a reduction in hospital beds by about 16% between 2010 and 2015 [62-64]. Against this background, connective spaces are reorganised and increased to ensure the appropriate circulation of patients, staff and medical

equipment. Furthermore, hospitals are being redesigned to make them more accessible and familiar, with the introduction of new services and facilities supporting the patients and visitors' experience.

These changings in the architectural features and layout of the healthcare interior spaces are evidence of the increasing complexity of hospital logistics.

For this reason, one of the future development of the work, which is going to be widen to other national and international healthcare facilities, is to analyse a number of intermediate results, always referred to the type of spaces, like the external surface, the heating and cooling energy needs, heat losses due to transmission and ventilation, etc., and investigate examples of inner variations if changing some architectural or functional features.

The aim is to define composite benchmarks for hospitals by taking into account differing energy intensities at a departmental level. Furthermore, being based on larger sample sizes, the work will increase the reliability of the established consumption figures. Such an approach will enable to accommodate the fast-moving changes in healthcare delivery – and their impacts on layout features of hospital interior spaces – as well as the large heterogeneity between hospital buildings. Albeit focussed on hospital buildings, the methodology has a much wider utility as it could be applied to other non-residential building types in temperate climates, even thanks to its ease of use.

References:

- [1] European Commission, Energy efficiency, Buildings. <https://ec.europa.eu/energy/en/topics/energy-efficiency/buildings> (accessed 10.11.17).
- [2] M. Economidou et al., *Europe's buildings under the microscope - A country-by-country review of the energy performance of buildings*, BPIE, Brussels, BE, 2011.
- [3] LCB Healthcare, *Low Carbon Buildings in the Healthcare Sector, State of the Art Report*, 2011.
- [4] International Energy Agency (IEA), *Transition to sustainable buildings: Strategies and opportunities to 2050*, OECD/IEA, 2013.
- [5] U.S. DoE, *International Energy Outlook 2016*, US Energy Information Administration (EIA) Report Number: DOE/EIA-0484, 2016.
- [6] J. Grözinger, T. Boermans, A. John, F. Wehringer, J. Seehusen, *Overview of Member States information on NZEBs: Background paper – final report*, Ecofys, 2014.
- [7] O.B. Kazanci, M. Skrupskelis, P. Sevela, G.K. Pavlov, B.W. Olesen, Sustainable heating, cooling and ventilation of a plus-energy house via photovoltaic/thermal panels, *Energy and Buildings*, Vol. 83, 2014, pp.122-129.
- [8] *Energy Efficiency Trends and Policies in the Household and Tertiary Sectors: An Analysis Based on the ODYSSEE and MURE Databases*, 2015. <http://www.odyssee-mure.eu/publications/br/energy-efficiency-trends-policies-buildings.pdf> (accessed 10.11.17).
- [9] European Commission, EU Buildings Datamapper, Share of non-residential in total building floor area. <https://ec.europa.eu/energy/en/eu-buildings-datamapper> (accessed 11.11.17).
- [10] G.K. Alexis, P. Liakos, A case study of a cogeneration system for a hospital in Greece. Economic and environmental impacts, *Applied Thermal Engineering*, Vol. 54, No.2, 2013, pp.488-496.
- [11] M.J. Eckelman, J. Sherman, Environmental impacts of the U.S. health care system and effects on public health, *PLoS One*, Vol. 11, No.6, 2016.
- [12] S. Schimschar, J. Grözinger, H. Korte, T. Boermans, V. Lilova, R. Bhar, Panorama of the European non-residential construction sector, Ecofys, 2011. http://www.leonardo-energy.com/sites/leonardo-energy/files/documents-and-links/European non-residential building stock - Final Report_v7.pdf (accessed 11.11.17).
- [13] Ministero della Salute, Nuovo Sistema Informativo Sanitario (NSIS), Elenco Aziende sanitarie locali e Strutture di ricovero. http://www.salute.gov.it/portale/documentazione/p6_2_8_1_1.jsp?id=13, 2017 (accessed 12.11.17).
- [14] B.C. Singer, W.F. Tschudi, *High performance healthcare buildings: a roadmap to improved energy efficiency*, Lawrence Berkeley National Laboratory, 2009.
- [15] V. Čongradac, B. Prebiračević, N. Jorgovanović, D. Stanišić, Assessing the energy consumption for heating and cooling in hospitals, *Energy and Buildings*, Vol. 48, 2012, pp.146-154.
- [16] A. Buonmano, F. Calise, G. Ferruzzi, A. Palombo, Dynamic energy performance analysis: Case study for energy efficiency retrofits of hospital buildings, *Energy*, Vol.78, 2014, pp.555-572.

- [17] J. Bujak, Heat consumption for preparing domestic hot water in hospitals, *Energy and Buildings*, Vol.42, No.7, 2010, pp.1047-1055.
- [18] F. Salata, I. Golasi, M. di Salvatore, A. de Lieto Vollaro, Energy and reliability optimization of a system that combines daylighting and artificial sources. A case study carried out in academic buildings, *Applied Energy*, Vol.169, 2016, pp.250-266.
- [19] T. Rohde, R. Martinez, Equipment and energy usage in a large teaching hospital in Norway, *Journal of Healthcare Engineering*, Vol.6, No.3, 2015, pp.419-33.
- [20] N. Christiansen, M. Kaltschmitt, F. Dzikowski, Electrical energy consumption and utilization time analysis of hospital departments and large scale medical equipment, *Energy and Buildings*, Vol.131, 2016, pp.172-183.
- [21] P. Morgenstern, M. Li, R. Raslan, P. Ruyssevelt, A. Wright, Benchmarking acute hospitals: Composite electricity targets based on departmental consumption intensities?, *Energy and Buildings*, Vol.118, 2016, pp.277-290.
- [22] N. Christiansen, M. Kaltschmitt, F. Dzikowski, F. Isensee, Electricity consumption of medical plug loads in hospital laboratories: Identification, evaluation, prediction and verification, *Energy and Buildings*, Vol.107, 2015, pp.392-406.
- [23] The World Bank. Health expenditure, total (% of GDP) | Data. <http://data.worldbank.org/indicator/SH.XPD.TOTL.ZS>, 2014 (accessed 12.11.17).
- [24] ASHRAE, *Advanced Energy Design Guide for Small Hospitals and Healthcare Facilities: 30% Energy Savings*, ASHRAE, 2009.
- [25] CIBSE TM54, Evaluating operational energy performance of buildings at the design stage, Chartered Institution of Building Services Engineers, CIBSE, 2013. <http://www.cibse.org/Knowledge/knowledge-items/detail?id=a0q20000008I7f7AAC> (accessed 12.11.17).
- [26] CarbonBuzz. <http://www.carbonbuzz.org/sectorbreakdown.jsp?id=4> (accessed 12.11.17).
- [27] A.C. Menezes, A. Cripps, D. Bouchlaghem, R. Buswell, Predicted vs. actual energy performance of non-domestic buildings: Using post-occupancy evaluation data to reduce the performance gap, *Applied Energy*, Vol.97, 2012, pp.355-364.
- [28] P. de Wilde, The gap between predicted and measured energy performance of buildings: A framework for investigation, *Automation in Construction*, Vol.41, 2014, pp.40-49.
- [29] F. Ascione, N. Bianco, C. De Stasio, G.M. Mauro, G.P. Vanoli, Multi-stage and multi-objective optimization for energy retrofitting a developed hospital reference building: A new approach to assess cost-optimality, *Applied Energy*, Vol.174, 2016, pp.37-68.
- [30] Z.A. Adamu, A.D.F. Price, M.J. Cook, Performance evaluation of natural ventilation strategies for hospital wards – A case study of Great Ormond Street Hospital, *Building and Environment*, Vol.56, 2012, pp.211-222.
- [31] T. Tsoutsos, E. Aloumpi, Z. Gkouskos, M. Karagiorgas, Design of a solar absorption cooling system in a Greek hospital, *Energy and Buildings*, Vol.42, No.2, 2010, pp.265-272.
- [32] A. Buonomano, U. Montanaro, A. Palombo, S. Santini, Dynamic building energy performance analysis: A new adaptive control strategy for stringent thermohygrometric indoor air requirements, *Applied Energy*, Vol.163, 2016, pp.361-386.
- [33] ASHRAE, *Advanced Energy Design Guide for Large Hospitals. Achieving 50% Energy Savings Toward a Net Zero Energy Building*, ASHRAE, 2012.
- [34] E. Bonnema, M. Leach, S. Pless, *Technical Support Document: Development of the Advanced Energy Design Guide for Large Hospitals – 50% Energy Savings*, NREL, 2013.
- [35] E. Bonnema, D. Studer, A. Parker, S. Pless, P. Torcellini, *Large Hospital 50% Energy Savings: Technical Support Document*, NREL, 2010.
- [36] E. Bonnema, S. Pless, I. Doebber, P. Torcellini, *Technical Support Document: Development of the Advanced Energy Design Guide for Small Hospitals and Healthcare Facilities - 30% Guide*, NREL, 2010.
- [37] H. Burpee, J. Loveland, *Targeting 100! Envisioning the high performance hospital: implications for a new, low energy, high performance prototype*, University of Washington, 2010.
- [38] C.A. Short, K.J. Lomas, R. Giridharan, A.J. Fair, Building resilience to overheating into 1960's UK hospital buildings within the constraint of the national carbon reduction target: Adaptive strategies, *Building and Environment*, Vol.55, 2012, pp.73-95.
- [39] K.J. Lomas, R. Giridharan, Thermal comfort standards, measured internal temperatures and thermal resilience to climate change of free-running buildings: A case-study of hospital

- wards, *Building and Environment*, Vol.55, 2012, pp.57-72.
- [40] F. Ascione, N. Bianco, R.F. De Masi, G.P. Vanoli, Rehabilitation of the building envelope of hospitals: Achievable energy savings and micro-climatic control on varying the HVAC systems in Mediterranean climates, *Energy and Buildings*, Vol.60, 2013, pp.125-138.
- [41] M. Ahmadzadehtalatapeh, Y.H. Yau, The application of heat pipe heat exchangers to improve the air quality and reduce the energy consumption of the air conditioning system in a hospital ward - A full year model simulation, *Energy and Buildings*, Vol.43, 2011, pp.2344-2355.
- [42] G. Pagliarini, C. Corradi, S. Rainieri, Hospital CHCP system optimization assisted by TRNSYS building energy simulation tool, *Applied Thermal Engineering*, Vol.44, 2012, pp.150-158.
- [43] D.B. do E. Santo, An energy and exergy analysis of a high-efficiency engine trigeneration system for a hospital: A case study methodology based on annual energy demand profiles, *Energy and Buildings*, Vol.76, 2014, pp.185-198.
- [44] A. Malkawi, G. Augenbroe, *Advanced building simulation*, Spon Press, 2003.
- [45] D. Kolokotsa, D. Rovas, E. Kosmatopoulos, K. Kalaitzakis, A roadmap towards intelligent net zero- and positive-energy buildings, *Solar Energy*, Vol. 85, No.12, 2011, pp.3067-3084.
- [46] V. Čongradac, B. Prebiračević, N. Petrovački, Methods for assessing energy savings in hospitals using various control techniques, *Energy and Buildings*, Vol.69, 2014, pp.85-92.
- [47] A. Bagnasco, F. Fresi, M. Saviozzi, F. Silvestro, A. Vinci, Electrical consumption forecasting in hospital facilities: An application case, *Energy and Buildings*, Vol.103, 2015, pp.261-270.
- [48] A.L. Zorita, M.A. Fernández-Temprano, L.-A. García-Escudero, O. Duque-Perez, A statistical modeling approach to detect anomalies in energetic efficiency of buildings, *Energy and Buildings*, Vol.110, 2016, pp.377-386.
- [49] C.R. Iddon, T.C. Mills, R. Giridharan, K.J. Lomas, The influence of hospital ward design on resilience to heat waves: An exploration using distributed lag models, *Energy and Buildings*, Vol.86, 2015, pp.573-588.
- [50] C.A. Balaras, E. Dascalaki, A. Gaglia, HVAC and indoor thermal conditions in hospital operating rooms, *Energy and Buildings*, Vol.39, 2007, pp.454-470.
- [51] A. Gimelli, M. Muccillo, Optimization criteria for cogeneration systems: Multi-objective approach and application in an hospital facility, *Applied Energy*, Vol.104, 2013, pp.910-923.
- [52] H. Cho, A.D. Smith, P. Mago, Combined cooling, heating and power: A review of performance improvement and optimization, *Applied Energy*, Vol.136, 2014, pp.168-185.
- [53] Agenzia Nazionale per i Servizi Sanitari Regionali, Progetto di ricerca finalizzata (ex art. 12, Dlgs 502/92), Principi guida tecnici, organizzativi e gestionali per la realizzazione e gestione di ospedali ad alta tecnologia e assistenza, *Monitor*. Supplement to n. 6, 2003.
- [54] N. Setola, *Percorsi, flussi e persone nella progettazione ospedaliera: l'analisi configurazionale, teoria e applicazione*, Firenze University Press, 2013.
- [55] R. Palumbo, *Metaprogettazione per l'edilizia ospedaliera*, BE-MA, 1993.
- [56] F. Rossi Prodi, A. Stocchetti, *L'architettura dell'ospedale*, Alinea, 1990.
- [57] *Enciclopedia medica italiana*, Vol.10, USES, 1983.
- [58] R. Choudhary, Energy analysis of the non-domestic building stock of Greater London, *Building and Environment*, Vol.51, 2012, No.243-254.
- [59] K.J. Lomas, Y. Ji, Resilience of naturally ventilated buildings to climate change: Advanced natural ventilation and hospital wards, *Energy and Buildings*, Vol.41, 2009, pp.629-653.
- [60] B.C. Singer, P. Mathew, S. Greenberg, W. Tschudi, D. Sartor, S. Strom, W. Vernon, M. Nash, L. Burch, *Hospital Energy Benchmarking Guidance -Version 1.0 LBNL Report*, Berkeley, Lawrence Berkeley National Laboratory, 2009.
- [61] A. Teke, O. Timur, Assessing the energy efficiency improvement potentials of HVAC systems considering economic and environmental aspects at the hospitals, *Renewable and Sustainable Energy Reviews*, Vol. 33, 2014, pp.224-235.
- [62] OECD, *OECD Health Statistics 2017*, OECD Publishing, 2017, <http://dx.doi.org/10.1787/health-data-en>.
- [63] OECD, *Health at a Glance 2017: OECD Indicators, Hospital beds*, OECD, 2017.
- [64] Eurostat, *Hospital beds*, 2017. http://ec.europa.eu/eurostat/statistics-explained/index.php/Healthcare_resource_statistics_-_beds (accessed 12.11.17).